



**rastelli**  
RUBINETTERIE



424S

SERPENTINA PORTAMANOMETRO, IN RAME NICHELATA  
COPPER COIL FOR MANOMETER HOLDER, NICKEL PLATED

Serpentina porta-manometro con attacco maschio fisso, calotta girevole e tubo Ø 8 mm.

Filettature UNI EN ISO 228-1.

Fluidi ammessi gas, vapori e liquidi non pericolosi

Temperatura massima di esercizio: 120° C

## INSTALLAZIONE E MESSA IN SERVIZIO

1. Le serpentine preservano il manometro, in quanto evitano i colpi di ariete e diminuiscono la temperatura del fluido, occorre quindi installarle prima del manometro collegandole a un rubinetto porta-manometro.
2. Per installare la serpentina, utilizzare appositi prodotti per la tenuta sui filetti, in funzione del fluido intercettato e agire con la chiave esclusivamente sull'esagono.
3. Per installare il manometro, avvitarlo fino in battuta, tenendo ferma la serpentina con l'esagono in alto.
4. Immettere il fluido nella linea.

## IMPIEGO

Non toccare le serpentine: in caso si utilizzino fluidi in temperatura, utilizzare guanti protettivi.

## MANUTENZIONE

Non sono previste operazioni di manutenzione

## SMALTIMENTO

Se la valvola opera a contatto con fluidi tossici, prendere le necessarie precauzioni ed effettuare la pulizia dai residui eventualmente intrappolati nella valvola. Il personale addetto deve essere adeguatamente istruito ed equipaggiato dei necessari dispositivi di protezione.

Prima dello smaltimento, smontare la valvola e suddividere i componenti in base al tipo di materiale. Consultare le schede prodotto per maggiori informazioni. Avviare i materiali così suddivisi al riciclaggio (per es. materiali metallici) o allo smaltimento, in accordo alla legislazione locale in vigore e nel rispetto dell'ambiente.

Pressure gauge coil with fixed male connection, swivel cap and ø 8 mm tube.

UNI EN ISO 228-1 threads.

Admitted fluids gases, vapors and non-dangerous liquids

Maximum working temperature: 120 ° C

## INSTALLATION AND USE

1. The serpentines preserve the pressure gauge, as they avoid water hammering and decrease the temperature of the fluid, therefore they must be installed before the pressure gauge by connecting them to a pressure gauge tap.
2. To install the coil, use special products to seal the threads, depending on the fluid intercepted and use the key exclusively on the hexagon.
3. To install the pressure gauge, screw it up to the stop, holding the coil with the hexagon at the top.  
4. Enter the fluid in the line.

## MAINTENANCE

The valve does not require maintenance.

## DISPOSAL

For valve operating with hazardous liquids(toxic, corrosive..) , if there is a possibility of residue remaining in the valve, take due safety precaution and carry out required cleaning operation. Personnel in charge must be trained and equipped with appropriate protection devices.

Prior to disposal, disassemble the valve and separate the component according to various materials. Please refer to product literature for more information. Forward sorted material to recycling (e.g. metallic materials) or dispose it, according to local and currently valid legislation taking into consideration the environment.

# MATERIALI / MATERIALS

**CORPO**  
Rame Cu999


**RACCORDI**  
Ottone CW614N

**FINITURA SUPERFICIALE**  
Nichelata

**BODY**  
Brass CW617N-UNI-EN 12165

**FITTINGS**  
Brass CW614N

**FINISHING**  
Nickel plated

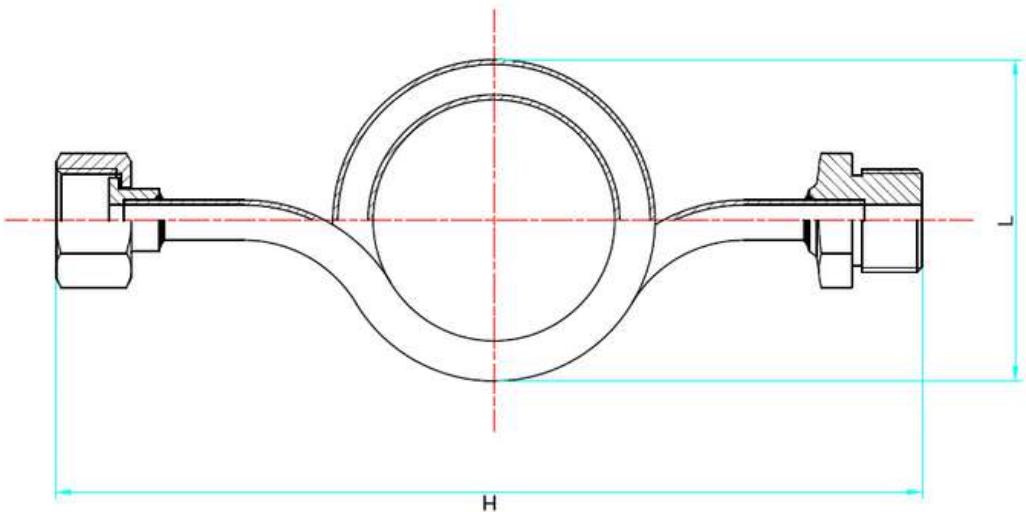

R"	L	H	PN
1/4"	64	172	25
3/8"	64	172	25
1/2"	64	172	25

Le misure riportate in tabella sono espresse in mm  
All measures in the charts are expressed in mm



Rastelli Rubinetterie S.r.l.  
Regione Monticelli, 10/14  
28045 INVORIO (NO) - ITALY  
Tel +39 0322 259691  
Fax +39 0322 254761  
Export: [export@rastelli.it](mailto:export@rastelli.it)  
Italia: [ordini@rastelli.it](mailto:ordini@rastelli.it)  
[www.rastelli.it](http://www.rastelli.it)